







Configuration Example		Portable Safety Distribution Boxes							     		
Number	Outputs	Sockets	Fuse protection	Residual current	Circuit breaker $I_{\Delta n}$	RCD Type A	Supply cable	with	Plug	Order No.	<b>Solid rubber housing</b> Series <b>ESSEN</b>

1	Earthing contact	—	—	25A/30mA/2p.	3 m	Earthing contact	<b>1010007</b>
---	------------------	---	---	--------------	-----	------------------	----------------



Input		PRCD-K		Output		Order No.
Plug with cable				Cable with coupling		
Solid rubber earthing contact	1.5 m	30 mA	1.5 m	Solid rubber earthing contact		<b>PR03K/S1,5K</b>




## ELSPRO PRODUCTS FOR YOUR SAFETY

**Selection of products conforming with DGUV Information 203-032 for the safe operation of mobile generators on building and installation sites**

For you at [www.elspro.de](http://www.elspro.de):

DGUV Information 203-032 "Selection and operation of mobile generators on building and installation sites" - current information to help in your choice of products. Electrical operating equipment on building and installation sites must be provided with special connection points but fulfil the safety requirements of the above DGUV document.

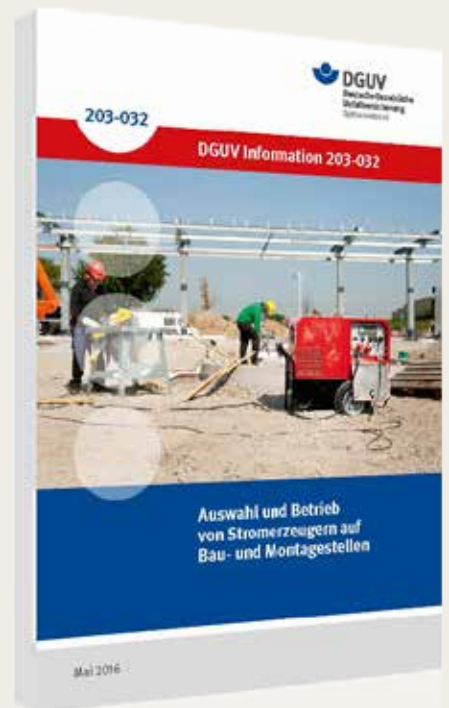

– Other versions on request / subject to changes, E&OE –

**Solid rubber housing**

Series  
HILDEN / FREIBURG  
AACHEN

Number	Outputs	Sockets	Fuse protection	Residual current Circuit breaker RCD Type A $I_n$ / $I_{\Delta n}$	Supply cable with Plug	Order No.
--------	---------	---------	-----------------	---	------------------------------	-----------



3 Earthing contact			—	3x 25A/30mA/2p.	3 m Earthing contact	<b>1310052</b>
--------------------	--	--	---	-----------------	----------------------	----------------



1 CEE 400V 16A 5p.			—	40A/30mA/4p.	3 m CEE 400V 16A 5p.	<b>1311102</b>
--------------------	--	--	---	--------------	----------------------	----------------



1 CEE 400V 32A 5p.			—	40A/30mA/4p.	3 m CEE 400V 32A 5p.	<b>1313320</b>
--------------------	--	--	---	--------------	----------------------	----------------










1 CEE 400V 16A 5p. 3 Earthing contact			— —	40A/30mA/4p. 3x 25A/30mA/2p.	3 m CEE 400V 16A 5p.	<b>1411154</b>
--	--	--	--------	---------------------------------	----------------------	----------------



1 CEE 400V 32A 5p. 1 CEE 400V 16A 5p. 4 Earthing contact			— 1 C-Aut. 3p. 4 FI/LS	40A/30mA/4p. 40A/30mA/4p. 16A/30mA/1p.+N	3 m CEE 400V 32A 5p.	<b>19533108</b>
--	--	--	------------------------------	--	----------------------	-----------------

– Other versions on request / subject to changes, E&OE –

Configuration Example		Portable Safety Distribution Boxes							     	
Number	Outputs	Sockets	Fuse protection	Residual current	RCD Type A Circuit breaker $I_{\Delta n}$	Supply cable	with	Plug	Order No.	<b>Solid rubber housing</b> Series <b>ESSEN</b>

1	Earthing contact IP66/68	—	—	25A/30mA/2p.	3 m	Earthing contact IP66/68	—	—	<b>1010016</b>	
---	--------------------------	---	---	--------------	-----	--------------------------	---	---	----------------	---

Input		PRCD-K	Output		Order No.
Plug with cable			Cable with coupling		
Solid rubber earthing contact IP66/68	1.5 m	30 mA IP55	1.5 m	Solid rubber earthing contact IP66/68	<b>PR03K/S1,5K/WD</b>




## ELSPRO PRODUCTS FOR YOUR SAFETY

**Selection of products conforming with DGUV Information 203-032 for the safe operation of mobile generators on building and installation sites**

For you at [www.elspro.de](http://www.elspro.de):

DGUV Information 203-032 "Selection and operation of mobile generators on building and installation sites" - current information to help in your choice of products. Electrical operating equipment on building and installation sites must be provided with special connection points but fulfil the safety requirements of the above DGUV document.

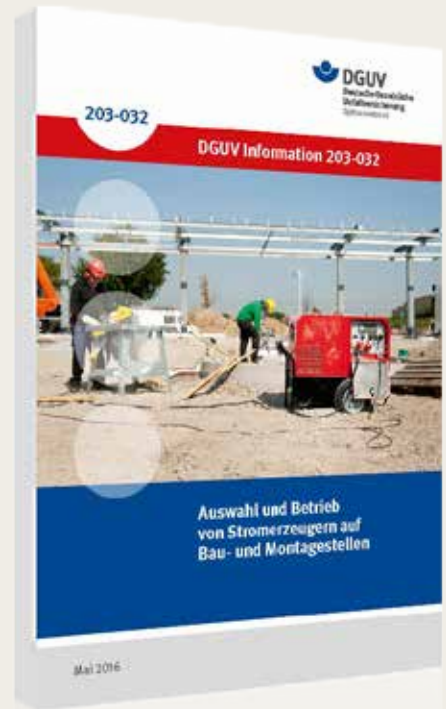

– Other versions on request / subject to changes, E&OE –

**Solid rubber housing**

Series  
HILDEN / FREIBURG  
AACHEN

Number	Outputs	Sockets	Fuse protection	Residual current Circuit breaker RCD Type A	Supply cable with Plug	Order No.
--------	---------	---------	-----------------	---	------------------------------	-----------



3 Earthing contact IP66/68	—	3x 25A/30mA/2p.	3 m	Earthing contact IP66/68	<b>1310047</b>
----------------------------	---	-----------------	-----	--------------------------	----------------



1 CEE 400V 16A 5p. IP67	—	40A/30mA/4p.	3 m	CEE 400V 16A 5p. IP67	<b>1311161</b>
-------------------------	---	--------------	-----	-----------------------	----------------



1 CEE 400V 32A 5p. IP67	—	40A/30mA/4p.	3 m	CEE 400V 32A 5p. IP67	<b>1313321</b>
-------------------------	---	--------------	-----	-----------------------	----------------



1 CEE 400V 16A 5p. IP67	—	40A/30mA/4p.	3 m	CEE 400V 16A 5p. IP67	<b>1411162</b>
3 Earthing contact IP66/68	—	3x 25A/30mA/2p.			



1 CEE 400V 32A 5p. IP67	—	40A/30mA/4p.	3 m	CEE 400V 32A 5p. IP67	<b>19533127</b>
1 CEE 400V 16A 5p. IP67	1 C-Aut. 3p.	40A/30mA/4p.			
4 Earthing contact IP66/68	4 FI/LS	16A/30mA/1p.+N			

– Other versions on request / subject to changes, E&OE –